

14

# SIGMA TECHNO ASSOCIATES

TECHNICAL SERVICES UNDER FACTORIES ACT, MPCB, MIDC & PESO

Ion 7, Office No. : 402, 4th Floor, Mumbai - Pune Highway, Pimpri, Pune - 411018

Telephone : 020 - 8484999784, Email.: s@sigmapatil.com Mobile : 9822745308

To,  
M/s. Fine ARC Systems Pvt. Ltd.  
Gat No. 408, Urawade, Mulshi, Pune.

Tax Invoice : STA/23/495

Date : 29.03.2023

PO. No.:

PO Date :


Your GST To. 27AAACF3131E1Z7

Our Bank Details :- KOTAK MAHINDRA BANK LTD  
Branch : EMPIRE ESTATE, CHINCHWAD, PUNE 411019  
ACCOUNT NUMBER : 4211211019  
IFSC CODE : KKBK0000725


GST NO : 27ANOPP1030E1Z7  
PAN NO : ANOPP1030F  
SAC CODE : 998333

| Sr.No   | Particular   | Qty / Nos | Rate/ Each | Amount (INR) |
|---|--|-----------|------------|--------------|
|   | Charges For, Testing of Pressure Vessels & Lifting Devices |           |            |              |
| 1   | Air Receiver   | 01 No.    | 700/-      | 700.00       |
| 2   | EOT Crane  | 02 Nos.   | 700/-      | 1400.00      |
| 3   | Hand Pallet Truck  | 02 Nos.   | 350/-      | 700.00       |
| 4   | Hyd. Manual Trolley  | 01 No.    | 350/-      | 350.00       |
| Sub Total   |  |           |            | 3150.00      |
| CGST 09 %   |  |           |            | 283.50       |
| SGST 09 %   |  |           |            | 283.50       |
| Grand Total : Three Thousand Seven Hundred Seventeen Only |  |           |            | 3717.00      |

SIGMA TECHNO ASSOCIATES

  
Authorized Signatory



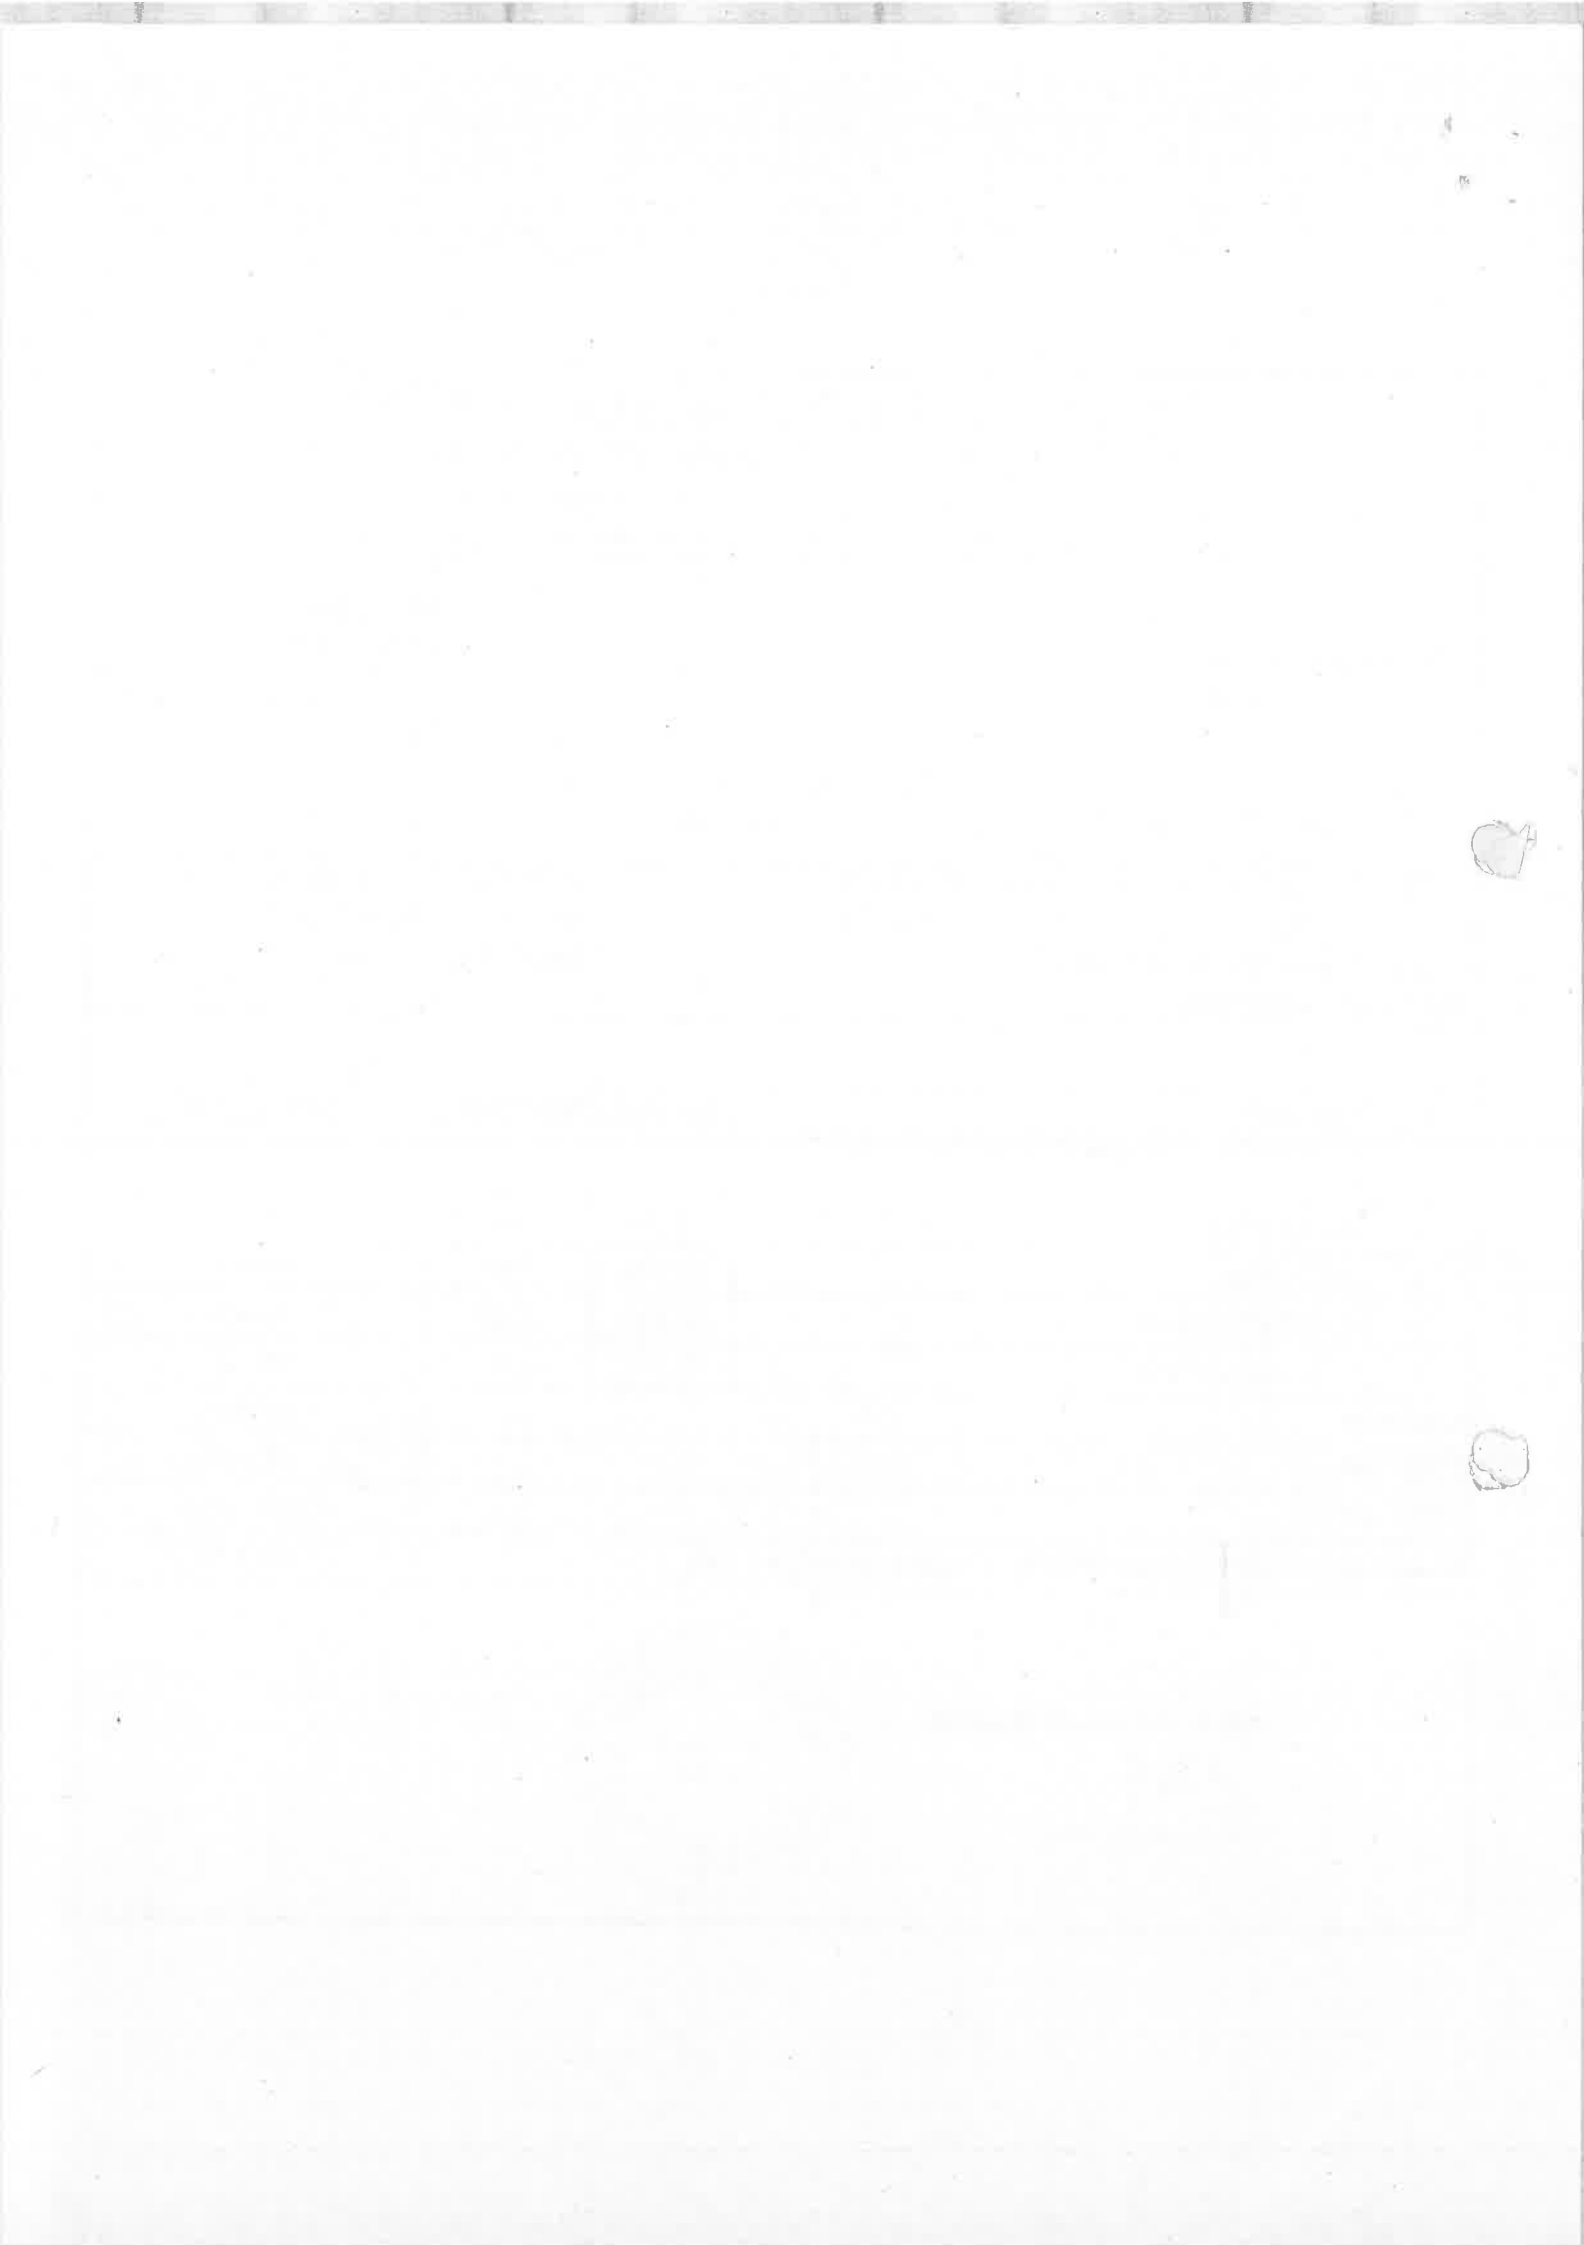



महाराष्ट्र शासन

औद्योगिक सुरक्षा व आरोग्य संचालनालय

सक्षम व्यक्ती प्रमाणपत्र

प्रमाणपत्र क्रमांक :- MS/DISH/CPC/B-067/2023

मी, श्री. मु. र. पाटील, प्रभारी संचालक, औद्योगिक सुरक्षा व आरोग्य, महाराष्ट्र राज्य, मुंबई, कारखाने अधिनियम, १९४८ च्या कलम २(c) आणि त्या अंतर्गत असलेल्या नियमांच्या नुसार दिलेल्या शक्तीचा वापर करून श्री. बुलकुंडे गोकुळ रामचंद्र, सक्षम व्यक्ती, प्रोफेशनल सर्जिसेस, आयओएन ०७, ऑफिस-४०२, ४था मजला, सेंट्रल मॉलच्या मागे, मुंबई पुणे रोड, पुणे-४११०१८ यांना महाराष्ट्र राज्यातील कारखान्यांत वापरल्या जाणाऱ्या उपकरणांच्या चाचण्या, परीक्षण, तपासणी व प्रमाणित करण्याकरीता खालील कलम व त्या अंतर्गत असलेल्या नियमानुसार महाराष्ट्र राज्यासाठी सक्षम व्यक्ती म्हणून मान्यता देत आहे. या प्रमाणपत्राची वैधता दिनांक ३१/१२/२०२५ पर्यंत आहे.

- i) Section 28 : Lifts and Hoists.
- ii) Section 29 : Lifting Machines, Chains, Ropes, Lifting Tackles.
- iii) Section 31 : Pressure Vessels and Plants

सदर प्रमाणपत्र खालील नमूद केलेल्या अटींच्या अधीन राहून देण्यात येत आहे :-

१. चाचणी, तपासणी व परीक्षण हे अधिनियम व त्या अंतर्गत असलेल्या नियमांच्या तरतुदीनुसार केले पाहिजे.
२. अधिनियम व त्या अंतर्गत असलेल्या नियमांमध्ये नमूद केले नसल्यास, प्रत्येक चाचणी/तपासणी ही संबंधित मानकानुसार केली पाहिजे.
३. चाचणी/तपासणी केल्यानंतर जर उपकरणांमध्ये दोष आढळले असतील, काही दुरुस्त्या अथवा फेरफार सुचविण्यात आले असतील, तर अशा सर्व प्रकरणांमध्ये चाचणी/तपासणीच्या प्रती संबंधित उप/सहाय्यक संचालक, औद्योगिक सुरक्षा व आरोग्य यांना ७ दिवसांत सादर कराव्यात.
४. चाचणी आणि तपासणीची पूर्वसूचना सक्षम व्यक्तीने संबंधित कार्यालयास देणे आवश्यक आहे.
५. चाचणी आणि तपासणी दरम्यान सक्षम व्यक्तीने प्रत्यक्ष उपस्थित रहावे आणि केलेल्या कामाचा तपशील, केलेली निरीक्षणे, दिलेले निर्देश इत्यादीची नोंद विहित नमुन्यातील रोज वहीत ठेवावी.
६. वापरण्यात येणारी उपकरणे व सुविधा या सदैव चांगल्या व कार्यक्षम अवस्थेत ठेवावीत आणि वेळोवेळी कॅलिब्रेट करून घ्यावीत व कॅलिब्रेशन प्रमाणपत्राची प्रत दरवर्षी संचालनालयास सादर करावी.
७. सक्षम व्यक्तीने सशर्त प्रमाणपत्रे जासी करू नयेत तसेच जारी केलेल्या प्रत्येक चाचणी/तपासणी प्रमाणपत्रावर, प्रमाणपत्र क्रमांक आणि वैधता कार्यकाल नमूद करावा.
८. वैधता कार्यकाल संपल्यानंतर चाचण्या/तपासण्या करू नयेत.
९. संचालक, औद्योगिक सुरक्षा व आरोग्य, महाराष्ट्र राज्य, मुंबई यांनी सदर सक्षम व्यक्ती प्रमाणपत्र रद्द करण्याचे विलोपन करण्याचे अथवा दुरुस्त करण्याचे अधिकार राखून ठेवले आहेत.
१०. सक्षम व्यक्ती प्रमाणपत्र नूतनीकरण करण्याकरीता अर्ज, वैधता कालावधी संपण्याआधी कमीत कमी दोन महिने केला पाहिजे.


क्र. औसुवआ/ निरीक्षण/सव्यप्र/४८९/ ७२० /६,  
औद्योगिक सुरक्षा व आरोग्य संचालनालय,  
कामगार भवन, ५ वा मजला, वांद्रे-कुर्ला संकुल,  
वांद्रे (पूर्व), मुंबई-४०० ०५९.

दिनांक :- 1 FEB 2023

MUKESH  
RAGHUNATH  
PATIL

(मु. र. पाटील)  
प्रभारी संचालक,  
औद्योगिक सुरक्षा व आरोग्य,  
महाराष्ट्र राज्य, मुंबई.

Digitally signed by MUKESH RAGHUNATH PATIL, DN: cn=MUKESH RAGHUNATH PATIL, o=MAHARASHTRA GOVT, email=mukesh.patil@maharashtra.gov.in, c=IN

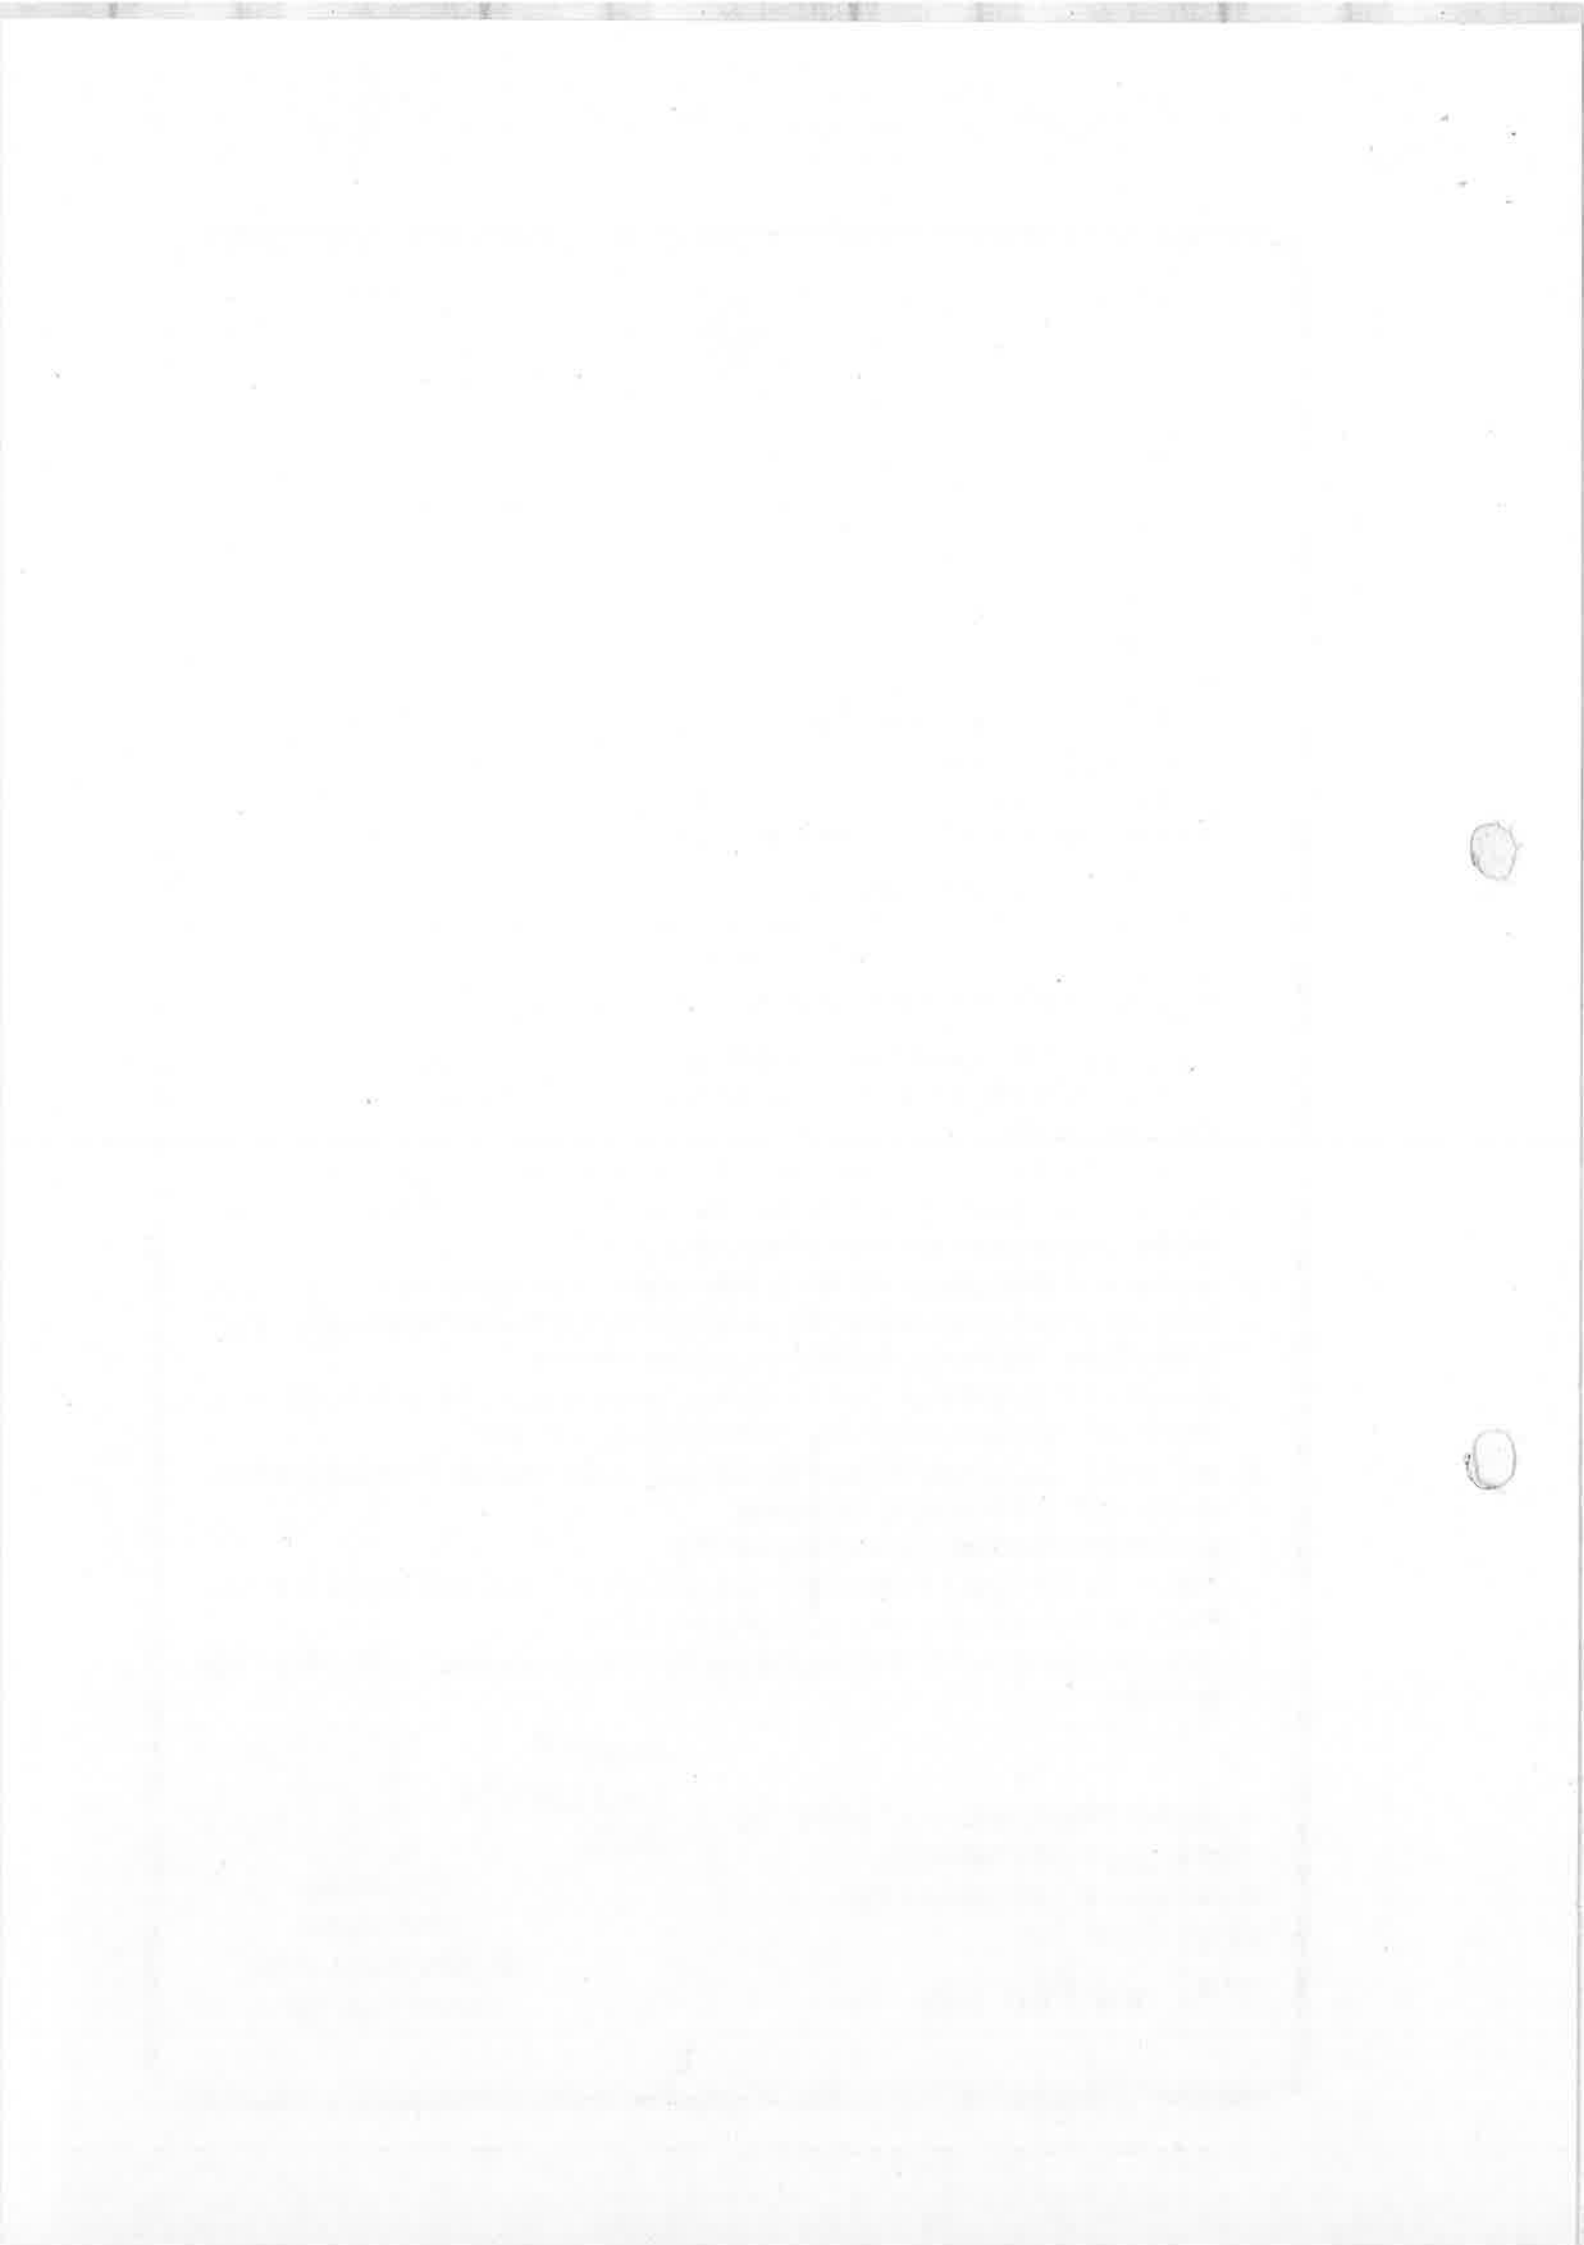

**FORM - 13**  
**REPORT OF EXAMINATION OF PRESSURE PLANT / VESSEL / GAS HOLDER**

(See Rules 65 and 73-A)

|       |   |   |
|-------|---|---|
| 1     | Name and address of the Factory   | M/s. Fine ARC Systems Pvt. Ltd.   |
|       |   | Gat No. 408, Urwade Mulshi Taluka : Mulshi, PUNE, 412115  |
| 2     | Name, Description and distinctive number of Pressure Plant / Vessel / Gas Holder  | Receiver<br>Horizontal Air Receiver<br>Sr. No. 1149 (03152644) , Cap : 0.3 M3,<br>Loc : Compressor Room |
| 3     | Name and address of maker   | M/s. Omega Thermo (Kaeser Compressor Ltd )<br>Pune  |
| 4     | Nature of process in which it is used   | For Storage and Supply of Compressed Air  |
| 5     | Particulars of Plant/Vessel-  |   |
| 5 (a) | Date of Construction  | 07-09-2019  |
| 5 (b) | Thickness of Walls  | 5.0 mm  |
| 5 (c) | Date on which it was first taken into use   | 11-12-2019  |
| 5 (d) | Safe working pressure recommended by maker  | 15 Kg/Cm <sup>2</sup>   |
| 5A    | Particulars of Plant/ Vessel/ Gas Holder  |   |
| a     | Parts of the gas holders examined by electronics or other accurate devices or by cutting sample discs and results thereof | Not Applicable  |
| b     | Particulars as to the condition of:-  |   |
|       | i) Crown  | Not Applicable  |
|       | ii) Side sheeting including grips and cups  | Not Applicable  |
|       | iii) Guiding mechanism (roller carriages, roller, pins, guide, ropes etc.   | Not Applicable  |
|       | iv) Tank  | Not Applicable  |
|       | v) Other structure, if any, columns (Framing and bracking)  | Not Applicable  |
| c     | Particulars as to the position of the lift at the time of examination   | Not Applicable  |
| d     | Particulars as to whether the tank and lifts were found sufficiently level for safe working                               | Not Applicable  |
| 6     | Date of -   |   |
| i)    | Last External Examination   | 07-06-2022  |
| ii)   | Last Internal Examination   |   |
| iii)  | Last Hydraulic Examination  | 07-09-2019  |
| iv)   | Last Ultrasonic Test  | 07-06-2022  |
| 6A    | By Whom it is carried out?  | BY MR. GOKUL R. BULKUNDE  |
| 7     | Whether lagging was removed for purpose of examination  | No Lagging  |
| 8     | Description of examinations carried out and findings...   |   |
| i     | External Examination (Give reasons if it is not carried out six monthly)  | Satisfactory  |
| ii    | Internal Examination (Give reasons if it is not carried out six monthly)  | Inaccessible  |
| iii   | Hydraulic Test (Give reasons if this is not carried out at interval of 2 years or 4 years.)                               | Suggested for hydro test  |
| iv    | Ultrasonic Test (Please quote number and date of the certificate issued by Chief Inspector,                               | Ultrasonically tested & found O.K Thickness Shell : 5.0 mm to 4.9 mm, D'End : 4.9 mm to 5.0 mm          |

**FORM - 13**  
**REPORT OF EXAMINATION OF PRESSURE PLANT / VESSEL / GAS HOLDER**

(See Rules 65 and 73-A)

|      |   |                                   |
|------|---|-----------------------------------|
|      | permitting ultrasonic test in lieu of internal examination and hydraulic test)  |                                   |
| 9    | Safe Working Pressure calculated as per methods given in sub rule 5 (c) (ii) for sizing cylinders-  | Not Applicable                    |
| 10   | Condition of Pressure Plant   |                                   |
| a    | Vessel  | Good                              |
| b    | Piping  | Good                              |
| 11   | Conditions of fittings and appliances   |                                   |
| i)   | Pressure Gauges   | OK                                |
| ii)  | Safety Valves   | OK                                |
| iii) | Stop Valve  | OK, Source Pressure is Lower      |
| iv)  | Reducing Valves (give reasons if not necessary)   | OK, Source Pressure is Lower      |
| v)   | Additional safety valve (required in case reducing valve is necessary)  | Not Applicable                    |
| vi)  | Other devices (please specify particularly in case of jacketed vessel)  | Not Applicable                    |
| vii) | Are all fittings and appliances properly maintained and in good condition, repairs if any required and period within which they should be executed. | Not Applicable                    |
| 12   | Safe working pressure recommended after examination (specify the allowances made for condition of working such as heat, corrosion etc.)             | 15 Kg/Cm <sup>2</sup>             |
| 13   | Specify repairs if any and period within which they should be executed  | NIL                               |
| 14   | Specify reduced working pressure pending repairs  | NIL                               |
| 15   | Other observation /conditions subject to which the plant is to be operated  | Air Receiver Is in Good Condition |

I certify that on **25-03-2023** the pressure plant / vessel described above was thoroughly cleaned and (so far as its construction permits) made accessible for thorough examination and for such tests as were necessary for thorough examination and that on the said date. I thoroughly examined this pressure vessel/Plant including its fittings and that the above is true report of my examination.

|                          |  |
|--------------------------|--|
| Name of Competent Person | MR GOKUL R. BULKUNDE   |
| Qualification            | AUTHORIZED COMPETENT PERSON<br>CPC No. MS/DISH/CPC/B-067/2023<br>CPC Valid up to (Dec. 2025) |
| Address                  | SIGMA TECHNO ASSOCIATES, PIMPRI, PUNE-411018   |
| Test Date / Due Date     | 25-03-2023 Due Date : 24-09-2023   |

Signature of Competent Person :

**Bulkunde  
Gokul  
Ramchandra**

Digitally signed by Bulkunde Gokul Ramchandra  
DN: c=IN, st=Maharashtra,  
2.5.4.20=0e473cccc798e13a55251a93a975d400cc0d14  
91d1f84c0fe207db89bcf3, postalCode=412114,  
street=Building No A3, Flat No302,Nilay Gat No  
288,Jadhav Wadi,Chikhali Bk,Chikhlee,Mulshi,Pune,  
pseudonym=cfb7d82d298f6db669e7ba9abaacf0b,  
title=8596,  
serialNumber=83cee82d1a2ca7351db3429f4a26b7d01  
8df34572bc4b3834f6095a7b10add6, o=Personal,  
cn=Bulkunde Gokul Ramchandra  
Date: 2023.03.29.10:23:00 +05'30'

## FORM - 11

(See Rule 62 &amp; 64)

## REPORT OF EXAMINATION OF HOIST, LIFT, LIFTING MACHINE, CHAINS, ROPES AND LIFTING TACKLE

|                                |   |   |
|--------------------------------|---|---|
| 1                              | Name of the Occupier  | MR SHRIKANT SITARAM PATHAK  |
| 2                              | Name and address of the Factory   | M/s. Fine ARC Systems Pvt. Ltd.<br>Gat No. 408, Urwade,<br>Tal : Mulshi, Dist : Pune  |
| 3A                             | Type, Identification numbers and description of hoist, lift, lifting machine, chains, ropes and lifting tackles.  | EOT Crane<br>EOT Crane 4 Fall X 12 mm rope dia,<br>Make : Electromech, Cap : 6 Ton, Sr. No. 361,<br>Loc : Bay -01               |
| 3B                             | Date of construction or reconstruction and the date when the hoist, lift, lifting machine, chains, rope and lifting tackles were first taken into use in the factory.                             | 05-11-2008  |
| 4                              | Date of last examinations made under section 28(1)(a)(ii) and 29(1)(a)(iii) and by whom it was carried out.   | 10-10-2021<br>BY MR GOKUL R. BULKUNDE   |
| 5A                             | Maintenance: (List of parts, if any, which were inaccessible) Are following parts of the hoist or lift properly maintained and in good working order? If not, state what defects have been found: |   |
|                                | a) Enclosure of hoist way or lift way.  | : Not Applicable  |
|                                | b) Landing Gates and Cage gate(s).  | : Not Applicable  |
|                                | c) Interlocks on the landing gates and cage gate(s).  | : Not Applicable  |
|                                | d) Other gates fastenings.  | : Not Applicable  |
|                                | e) Cage and platform and fittings, cage guides, buffers, interior of the hoist way or lift way.   | : Not Applicable  |
|                                | f) Overrunning devices.   | : Not Applicable  |
|                                | g) Suspension ropes or chains and their attachments.  | : OK  |
|                                | h) Safety gear i.e. arrangements for preventing fall of platform or cage brakes.  | : Not Applicable  |
|                                | i) Brakes   | : OK  |
|                                | j) Work of spur gearing.  | : Not Applicable  |
| k) Other electrical equipment. | : Not Applicable  |   |
| l) Other parts.                | : Not Applicable  |   |
| 5B                             | Date and number of the certificate relating to any test and examination made under sub-rule (1) of rule 64 together with the name of the person who issued the certificates.                      | 25-03-2023<br>BY MR GOKUL R. BULKUNDE   |
| 5C                             | i) Date of annealing or their heat treatment of the chain and lifting tackle carried out under sub-rule (5) of Rule 64 and by whom it was carried out.  | : Not Applicable  |
|                                | ii) Particulars of any defect found at any such examination or after annealing and affecting the safe working load and of the steps taken to remedy such defect.                                  | : NIL   |
| 6                              | Repairs, renewals or alterations (if any) required and the period within which they should be executed and maximum safe working load subject to repairs, renewals or alterations (if any).        | Detailed Visual Inspection and Test has been carried out after test performance above EOT Crane found in good working condition |

## FORM - 11

(See Rule 62 &amp; 64)

## REPORT OF EXAMINATION OF HOIST, LIFT, LIFTING MACHINE, CHAINS, ROPES AND LIFTING TACKLE

I/We certify that on **25-03-2023** I/We thoroughly examined the hoist or lift, lifting machine, ropes and lifting tackles and details of examination/tests carried out is enclosed herewith that the above is a correct report of the result. .

|                          |  |
|--------------------------|--|
| Name of Competent Person | MR GOKUL R. BULKUNDE   |
| Qualification            | AUTHORIZED COMPETENT PERSON<br>CPC No. MS/DISH/CPC/B-067/2023<br>CPC Valid up to (Dec. 2025) |
| Address                  | SIGMA TECHNO ASSOCIATES, PIMPRI, PUNE-411018.  |
| Test Date / Due Date     | <b>25-03-2023</b> <b>Due Date : 24-03-2024</b>   |

Signature of Competent Person : **Bulkunde  
Gokul  
Ramchandra**

Digitally signed by Bulkunde Gokul Ramchandra  
DN: c=IN, st=Maharashtra,  
2.5.4.20=0e473ccc798e13a55251a93a975d400c  
c0d1491d1f8b4c0e20f7db89bcf3,  
postalCode=412114, street=Building NoA3, Flat  
No302,Nilay Gat No 288,Jadhav Wadi,Chikhali  
Bk,Chikhlee,Mulshi,Pune,  
pseudonym=cfb7d82d29ffc6db669e7ba9abaac  
f0b, title=8596,  
serialNumber=83cee82d1a2ca7351db3429f4a2  
6b7d018df34572bc4b3834f6095a7b10add6,  
o=Personal, cn=Bulkunde Gokul Ramchandra  
Date: 2023.03.29 10:21:20 +05'30'



**FORM 11**  
(See Rule 62 & 64)

**REPORT OF EXAMINATION OF HOIST, LIFT, LIFTING MACHINE, CHAINS, ROPES AND LIFTING TACKLE**

|                                |   |   |
|--------------------------------|---|---|
| 1                              | Name of the Occupier  | MR SHRIKANT SITARAM PATHAK  |
| 2                              | Name and address of the Factory   | M/s. Fine ARC Systems Pvt. Ltd.<br>Gat No. 408, Urwade,<br>Tal : Mulshi, Dist : Pune  |
| 3A                             | Type, Identification numbers and description of hoist, lift, lifting machine, chains, ropes and lifting tackles.  | EOT Crane<br>EOT Crane 4 Fall X 12 mm rope dia,<br>Make : Electromech, Cap : 6 Ton, Sr. No. 1059,<br>Loc : Bay -02              |
| 3B                             | Date of construction or reconstruction and the date when the hoist, lift, lifting machine, chains, rope and lifting tackles were first taken into use in the factory.                             | 05-11-2008  |
| 4                              | Date of last examinations made under section 28(1)(a)(ii) and 29(1)(a)(iii) and by whom it was carried out.   | 10-10-2021<br>BY MR GOKUL R. BULKUNDE   |
| 5A                             | Maintenance: (List of parts, if any, which were inaccessible) Are following parts of the hoist or lift properly maintained and in good working order? If not, state what defects have been found: |   |
|                                | a) Enclosure of hoist way or lift way.  | Not Applicable  |
|                                | b) Landing Gates and Cage gate(s).  | Not Applicable  |
|                                | c) Interlocks on the landing gates and cage gate(s).  | Not Applicable  |
|                                | d) Other gates fastenings.  | Not Applicable  |
|                                | e) Cage and platform and fittings, cage guides, buffers, interior of the hoist way or lift way.   | Not Applicable  |
|                                | f) Overrunning devices.   | Not Applicable  |
|                                | g) Suspension ropes or chains and their attachments.  | OK  |
|                                | h) Safety gear i.e. arrangements for preventing fall of platform or cage brakes.  | Not Applicable  |
|                                | i) Brakes   | OK  |
|                                | j) Work of spur gearing.  | Not Applicable  |
| k) Other electrical equipment. | Not Applicable  |   |
| l) Other parts.                | Not Applicable  |   |
| 5B                             | Date and number of the certificate relating to any test and examination made under sub-rule (1) of rule 64 together with the name of the person who issued the certificates.                      | 25-03-2023<br>BY MR GOKUL R. BULKUNDE   |
| 5C                             | i) Date of annealing or their heat treatment of the chain and lifting tackle carried out under sub-rule (5) of Rule 64 and by whom it was carried out.  | Not Applicable  |
|                                | ii) Particulars of any defect found at any such examination or after annealing and affecting the safe working load and of the steps taken to remedy such defect.                                  | NIL   |
| 6                              | Repairs, renewals or alterations (if any) required and the period within which they should be executed and maximum safe working load subject to repairs, renewals or alterations (if any).        | Detailed Visual Inspection and Test has been carried out after test performance above EOT Crane found in good working condition |

FORM - 11  
(See Rule 62 & 64)

REPORT OF EXAMINATION OF HOIST, LIFT, LIFTING MACHINE, CHAINS, ROPES AND LIFTING TACKLE

I/We certify that on **25-03-2023** I/We thoroughly examined the hoist or lift, lifting machine, ropes and lifting tackles and details of examination/tests carried out is enclosed herewith that the above is a correct report of the result.

|                          |  |
|--------------------------|--|
| Name of Competent Person | MR GOKUL R. BULKUNDE   |
| Qualification            | AUTHORIZED COMPETENT PERSON<br>CPC No. MS/DISH/CPC/B-067/2023<br>CPC Valid up to (Dec. 2025) |
| Address                  | SIGMA TECHNO ASSOCIATES, PIMPRI, PUNE-411018.  |
| Test Date / Due Date     | <b>25-03-2023</b> <b>Due Date : 24-03-2024</b>   |

Signature of Competent Person : **Bulkunde  
Gokul  
Ramchandra**

Digitally signed by Bulkunde Gokul Ramchandra  
DN: c=IN, st=Maharashtra,  
2.5.4.20=0c473cccc798e13a55251a93a975d400  
cfd0d1491d1f8b4c0e20f7db89bcff3,  
postalCode=412114, street=Building NoA3, Flat  
No302, Nilay Gat No 288, Jadhav Wadi, Chikhali  
BK, Chikhlee, Mulshi, Pune,  
pseudonym=cfb7d82d298fc6db669e7ba9abaac  
f0b, title=8596,  
serialNumber=83cee82d1a2caf7351db3429f4a2  
6b7d018df34573bc4b3834f6095a7b10add6,  
o=Personal, cn=Bulkunde Gokul Ramchandra  
Date: 2023.03.29 10:21:38 +05'30'

## FORM - 11

(See Rule 62 &amp; 64)

## REPORT OF EXAMINATION OF HOIST, LIFT, LIFTING MACHINE, CHAINS, ROPES AND LIFTING TACKLE

|                                |   |   |
|--------------------------------|---|---|
| 1                              | Name of the Occupier  | MR SHRIKANT SITARAM PATHAK  |
| 2                              | Name and address of the Factory   | M/s. Fine ARC Systems Pvt. Ltd.<br>Gat No. 408, Urwade,<br>Tal : Mulshi, Dist : Pune  |
| 3A                             | Type, Identification numbers and description of hoist, lift, lifting machine, chains, ropes and lifting tackles.  | Pallet Truck<br>Hand Pallet Truck,<br>Id. No. HPT 01, Make : Asmita Enterprises,<br>Cap : 02 Ton  |
| 3B                             | Date of construction or reconstruction and the date when the hoist, lift, lifting machine, chains, rope and lifting tackles were first taken into use in the factory.                             | 10-10-2017  |
| 4                              | Date of last examinations made under section 28(1)(a)(ii) and 29(1)(a)(iii) and by whom it was carried out.   | 10-10-2021<br>BY MR GOKUL R. BULKUNDE   |
| 5A                             | Maintenance: (List of parts, if any, which were inaccessible) Are following parts of the hoist or lift properly maintained and in good working order? If not, state what defects have been found: |   |
|                                | a) Enclosure of hoist way or lift way.  | Not Applicable  |
|                                | b) Landing Gates and Cage gate(s).  | Not Applicable  |
|                                | c) Interlocks on the landing gates and cage gate(s).  | Not Applicable  |
|                                | d) Other gates fastenings.  | Not Applicable  |
|                                | e) Cage and platform and fittings, cage guides, buffers, interior of the hoist way or lift way.   | Not Applicable  |
|                                | f) Overrunning devices.   | Not Applicable  |
|                                | g) Suspension ropes or chains and their attachments.  | OK  |
|                                | h) Safety gear i.e. arrangements for preventing fall of platform or cage brakes.  | Not Applicable  |
|                                | i) Brakes   | Not Applicable  |
|                                | j) Work of spur gearing.  | Not Applicable  |
| k) Other electrical equipment. | Not Applicable  |   |
| l) Other parts.                | Not Applicable  |   |
| 5B                             | Date and number of the certificate relating to any test and examination made under sub-rule (1) of rule 64 together with the name of the person who issued the certificates.                      | 25-03-2023<br>BY MR GOKUL R. BULKUNDE   |
| 5C                             | i) Date of annealing or their heat treatment of the chain and lifting tackle carried out under sub-rule (5) of Rule 64 and by whom it was carried out.  | Not Applicable  |
|                                | ii) Particulars of any defect found at any such examination or after annealing and affecting the safe working load and of the steps taken to remedy such defect.                                  | NIL   |
| 6                              | Repairs, renewals or alterations (if any) required and the period within which they should be executed and maximum safe working load subject to repairs, renewals or alterations (if any).        | Detailed Visual Inspection and Test has been carried out after test performance above Hand Pallet Truck found in good working condition |

## FORM - 11

(See Rule 62 &amp; 64)

## REPORT OF EXAMINATION OF HOIST, LIFT, LIFTING MACHINE, CHAINS, ROPES AND LIFTING TACKLE

I/We certify that on **25-03-2023** I/We thoroughly examined the hoist or lift, lifting machine, ropes and lifting tackles and details of examination/tests carried out is enclosed herewith that the above is a correct report of the result.

|                          |  |
|--------------------------|--|
| Name of Competent Person | MR GOKUL R. BULKUNDE   |
| Qualification            | AUTHORIZED COMPETENT PERSON<br>CPC No. MS/DISH/CPC/B-067/2023<br>CPC Valid up to (Dec. 2025) |
| Address                  | SIGMA TECHNO ASSOCIATES, PIMPRI, PUNE-411018.  |
| Test Date / Due Date     | <b>25-03-2023</b> <b>Due Date : 24-03-2024</b>   |

Signature of Competent Person : **Bulkunde  
Gokul  
Ramchandra**

Digitally signed by Bulkunde Gokul Ramchandra  
DN: cn=PI, st=Maharashtra,  
2.5.4.20=0c473ccc798e13a55251a93a975d409cc  
f0d1491d1f6b4c0fc207db9b9bctf3,  
postalCode=412114, street=Building NoA3, Flat  
No302,Nilay Gat No 788,Jadhav Wadi,Chikhali  
Bi,Chikhlee,Mulshi,Pune,  
pseudonym=cb7d82d298fc6db669e7ba9abaacf  
0b, title=AS96,  
serialNumber=83ccc82d1a2caf73516b3429fa26  
b7d018df34572bc4b3834f6095a7b10add6,  
o=Personal, cn=Bulkunde Gokul Ramchandra  
Date: 2023.03.29 16:21:53 +05'30'

## FORM - 11

(See Rule 62 &amp; 64)

## REPORT OF EXAMINATION OF HOIST, LIFT, LIFTING MACHINE, CHAINS, ROPES AND LIFTING TACKLE

|                                |   |   |
|--------------------------------|---|---|
| 1                              | Name of the Occupier  | MR SHRIKANT SITARAM PATHAK  |
| 2                              | Name and address of the Factory   | M/s. Fine ARC Systems Pvt. Ltd.<br>Gat No. 408, Urwade,<br>Tal : Mulshi, Dist : Pune  |
| 3A                             | Type, Identification numbers and description of hoist, lift, lifting machine, chains, ropes and lifting tackles.  | Pallet Truck<br>Hand Pallet Truck,<br>Id. No. HPT 02, Make : Asmita Enterprises,<br>Cap : 02 Ton  |
| 3B                             | Date of construction or reconstruction and the date when the hoist, lift, lifting machine, chains, rope and lifting tackles were first taken into use in the factory.                             | 10-10-2017  |
| 4                              | Date of last examinations made under section 28(1)(a)(ii) and 29(1)(a)(iii) and by whom it was carried out.   | 10-10-2021<br>BY MR GOKUL R. BULKUNDE   |
| 5A                             | Maintenance: (List of parts, if any, which were inaccessible) Are following parts of the hoist or lift properly maintained and in good working order? If not, state what defects have been found: |   |
|                                | a) Enclosure of hoist way or lift way.  | Not Applicable  |
|                                | b) Landing Gates and Cage gate(s).  | Not Applicable  |
|                                | c) Interlocks on the landing gates and cage gate(s).  | Not Applicable  |
|                                | d) Other gates fastenings.  | Not Applicable  |
|                                | e) Cage and platform and fittings, cage guides, buffers, interior of the hoist way or lift way.   | Not Applicable  |
|                                | f) Overrunning devices.   | Not Applicable  |
|                                | g) Suspension ropes or chains and their attachments.  | Not Applicable  |
|                                | h) Safety gear i.e. arrangements for preventing fall of platform or cage brakes.  | Not Applicable  |
|                                | i) Brakes   | Not Applicable  |
| j) Work of spur gearing.       | Not Applicable  |   |
| k) Other electrical equipment. | Not Applicable  |   |
| l) Other parts.                | Not Applicable  |   |
| 5B                             | Date and number of the certificate relating to any test and examination made under sub-rule (1) of rule 64 together with the name of the person who issued the certificates.                      | 25-03-2023<br>BY MR GOKUL R. BULKUNDE   |
| 5C                             | i) Date of annealing or their heat treatment of the chain and lifting tackle carried out under sub-rule (5) of Rule 64 and by whom it was carried out.  | Not Applicable  |
|                                | ii) Particulars of any defect found at any such examination or after annealing and affecting the safe working load and of the steps taken to remedy such defect.                                  | NIL   |
| 6                              | Repairs, renewals or alterations (if any) required and the period within which they should be executed and maximum safe working load subject to repairs, renewals or alterations (if any).        | Detailed Visual Inspection and Test has been carried out after test performance above Hand Pallet Truck found in good working condition |

FORM - 11  
(See Rule 62 & 64)

REPORT OF EXAMINATION OF HOIST, LIFT, LIFTING MACHINE, CHAINS, ROPES AND LIFTING TACKLE

I/We certify that on **25-03-2023** I/We thoroughly examined the hoist or lift, lifting machine, ropes and lifting tackles and details of examination/tests carried out is enclosed herewith that the above is a correct report of the result.

|                          |  |
|--------------------------|--|
| Name of Competent Person | MR GOKUL R. BULKUNDE   |
| Qualification            | AUTHORIZED COMPETENT PERSON<br>CPC No. MS/DISH/CPC/B-067/2023<br>CPC Valid up to (Dec. 2025) |
| Address                  | SIGMA TECHNO ASSOCIATES, PIMPRI, PUNE-411018.  |
| Test Date / Due Date     | <b>25-03-2023</b> <b>Due Date : 24-03-2024</b>   |

Signature of Competent Person : **Bulkunde  
Gokul  
Ramchandra**

Digitally signed by Bulkunde Gokul Ramchandra  
DN: c=IN, st=Maharashtra,  
2.5.4.20=0c473ccc798e13a55251a93a975d400cc  
f0d1491d1f8b4c0e20f7db89bcf3,  
postalCode=412114, street=Building NoA3, Flat  
No302,Nilay Gat No 288, Jadhav Wadi, Chikhali  
Bk, Chikhlee, Mulshi, Pune,  
pseudonym=cfb7d82d298fc6db669e7ba9abaacf  
0b, title=8596,  
serialNumber=83cee82d1a2caf7351db1429f4a26  
b7d018df34572bc4b3834f6095a7b10add6,  
o=Personal, cn=Bulkunde Gokul Ramchandra  
Date: 2023.03.29 10:22:09 +05'30'

## FORM - 11

(See Rule 62 &amp; 64)

## REPORT OF EXAMINATION OF HOIST, LIFT, LIFTING MACHINE, CHAINS, ROPES AND LIFTING TACKLE

|                                |   |  |
|--------------------------------|---|--|
| 1                              | Name of the Occupier  | MR SHRIKANT SITARAM PATHAK   |
| 2                              | Name and address of the Factory   | M/s. Fine ARC Systems Pvt. Ltd.<br>Gat No. 408, Urwade,<br>Tal : Mulshi, Dist : Pune   |
| 3A                             | Type, Identification numbers and description of hoist, lift, lifting machine, chains, ropes and lifting tackles.  | Hydraulic Manual Trolley,<br>Model No. MS-10, Cap : 01 Ton, Loc : Assly,<br>Make : Maini Material Handling                                     |
| 3B                             | Date of construction or reconstruction and the date when the hoist, lift, lifting machine, chains, rope and lifting tackles were first taken into use in the factory.                             | 17-05-2006   |
| 4                              | Date of last examinations made under section 28(1)(a)(ii) and 29(1)(a)(iii) and by whom it was carried out.   | 10-10-2021<br>BY MR GOKUL R. BULKUNDE  |
| 5A                             | Maintenance: (List of parts, if any, which were inaccessible) Are following parts of the hoist or lift properly maintained and in good working order? If not, state what defects have been found: |  |
|                                | a) Enclosure of hoist way or lift way.  | Not Applicable   |
|                                | b) Landing Gates and Cage gate(s).  | Not Applicable   |
|                                | c) Interlocks on the landing gates and cage gate(s).  | Not Applicable   |
|                                | d) Other gates fastenings.  | Not Applicable   |
|                                | e) Cage and platform and fittings, cage guides, buffers, interior of the hoist way or lift way.   | Not Applicable   |
|                                | f) Overrunning devices.   | Not Applicable   |
|                                | g) Suspension ropes or chains and their attachments.  | Not Applicable   |
|                                | h) Safety gear i.e. arrangements for preventing fall of platform or cage brakes.  | Not Applicable   |
|                                | i) Brakes   | Not Applicable   |
|                                | j) Work of spur gearing.  | Not Applicable   |
| k) Other electrical equipment. | Not Applicable  |  |
| l) Other parts.                | Not Applicable  |  |
| 5B                             | Date and number of the certificate relating to any test and examination made under sub-rule (1) of rule 64 together with the name of the person who issued the certificates.                      | 25-03-2023<br>BY MR GOKUL R. BULKUNDE  |
| 5C                             | i) Date of annealing or their heat treatment of the chain and lifting tackle carried out under sub-rule (5) of Rule 64 and by whom it was carried out.  | Not Applicable   |
|                                | ii) Particulars of any defect found at any such examination or after annealing and affecting the safe working load and of the steps taken to remedy such defect.                                  | NIL  |
| 6                              | Repairs, renewals or alterations (if any) required and the period within which they should be executed and maximum safe working load subject to repairs, renewals or alterations (if any).        | Detailed Visual Inspection and Test has been carried out after test performance above Hydraulic Manual Trolley found in good working condition |

FORM - 11

(See Rule 62 & 64)

REPORT OF EXAMINATION OF HOIST, LIFT, LIFTING MACHINE, CHAINS, ROPES AND LIFTING TACKLE

I/We certify that on **25-03-2023** I/We thoroughly examined the hoist or lift, lifting machine, ropes and lifting tackles and details of examination/tests carried out is enclosed herewith that the above is a correct report of the result.

|                          |  |
|--------------------------|--|
| Name of Competent Person | MR GOKUL R. BULKUNDE   |
| Qualification            | AUTHORIZED COMPETENT PERSON<br>CPC No. MS/DISH/CPC/B-067/2023<br>CPC Valid up to (Dec. 2025) |
| Address                  | SIGMA TECHNO ASSOCIATES, PIMPRI, PUNE-411018.  |
| Test Date / Due Date     | <b>25-03-2023</b> <b>Due Date : 24-03-2024</b>   |

Signature of Competent Person :

**Bulkunde  
Gokul  
Ramchandra**

Digitally signed by Bulkunde Gokul Ramchandra  
DN: c=IN, st=Maharashtra,  
2.5.4.20=6c473ccc798e13a55251a91a975d400  
c10d1491d1fbb4c0fe20f7db69bcffa,  
postalCode=412114, street=Building NoA3, Flat  
No102,Mjay Gat No 288,Jadhav Wadi,Chikhali  
Bk,Chikhale,Muhhi,Pune,  
pseudonym=cb7d82d298fc6db669e7ba9abaac  
f0b, title=8596,  
serialNumber=83cee82d1a2caf7351db3429f4a2  
6b7d018df34572bc4b3834f6095a7b10add6,  
o=Personal, cn=Bulkunde Gokul Ramchandra  
Date: 2023.03.29 10:22:25 +05'30'